



University at Buffalo

Center for Inclusive Design and Environmental Access School of Architecture and Planning

> 309 Hayes Hall Buffalo, NY 14214-8030 TEL: (716) 829-5902

NOT FOR CONSTRUCTION

NOTES

1. EXTERIOR WALL STUDS ARE ASSUMED 2" X 8" (NOM.). VERIFY IF SUFFICIENT GIVEN REGIONAL ENERGY REQUIREMENTS. 2. INTERIOR WALL STUDS ARE ASSUMED 2" X 4"

3. WALLS ARE ASSUMED 92-5/8" PRE-CUT STUDS W/ ONE BOTTOM PLATE & TWO TOP PLATES. 4. FLOOR JOISTS ARE ASSUMED 2" X 10" (NOM.).

VERIFY IF SUFFICIENT BASED ON LOCAL CODE & WOOD SPECIES/GRADE. 5. SUBFLOORS ARE ASSUMED 5/8" PLYWOOD. 6. EXTERIOR WALL SHEATHING IS ASSUMED 5/8" PLYWOOD. SIDING IS NOT DEPICTED IN PLAN VIEW.

7. INTERIOR WALL FINISHES ARE ASSUMED 1/2" DRYWALL. 8. CEILING FINISH IS ASSUMED 5/8" DRYWALL.

9. INTERIOR FLOOR FINISHES ARE NOT DEPICTED IN THIS WORK. FLOOR FINISHES TO BE SMOOTH, STABLE, FIRM, & SLIP-RESISTANT. WHERE CARPET IS PROVIDED, CARPET PILE IS TO BE NO HIGHER THAN $\frac{1}{2}$ ". TRANSITIONS BETWEEN FLOOR FINISHES SHOULD BE SMOOTH & FLUSH WHEREVER POSSIBLE. WHERE NOT POSSIBLE, THE MAXIMUM VERTICAL LEVEL CHANGE IS $\frac{1}{4}$ ". THE MAXIMUM BEVELED LEVEL CHANGE IS $\frac{1}{2}$ ", PROVIDED THE TOP 1/4" IS BEVELED AT A MAXIMUM

SLOPE OF 1:2. 10. ROOF SLOPES ARE EQUAL ON EITHER SIDE OF RIDGE UNLESS OTHERWISE NOTED.

11. COORDINATE DIMENSIONS AT CLOSETS W/ INTENDED ELEVATOR SPECIFICATIONS, WHERE APPLICABLE.

12. HARDSCAPE SLOPES INDICATED FOR REFERENCE ONLY. ACTUAL SLOPES VARY BY SITE. SIDEWALK SLOPES ARE NOT TO EXCEED 5% TO REMAIN WHEELCHAIR ACCESSIBLE WITHOUT THE NEED FOR HANDRAILS.

13. ALL DIMENSIONS SHOWN ARE MEASURED FROM FACE-OF-STUD UNLESS OTHERWISE NOTED.

ABBREVIATIONS

CLR. - CLEAR F.F. - FINISH FLOOR T.O. - TOP OF

LifeHouse

1 STORY: 2 BED, 2 BATH HOME

DATE

2020


Dimensioned Plans

A-101


Door Schedule								
Door								
Number	Width	th Height Thickness		Comments				
100	3' - 6"	7' - 8"	0' - 1 3/4"					
101	5' - 0"	7' - 0"	0' - 1 1/2"	Bifold				
102	5' - 0"	7' - 0"	0' - 1 1/2"	Bifold				
103	6' - 0"	7' - 0"	0' - 1 1/2"	Paired				
104	5' - 0"	7' - 0"	0' - 1 1/2"	Sliding				
105	5' - 0"	7' - 0"	0' - 1 1/2"	Sliding				
106	2' - 8"	7' - 0"	0' - 1 1/2"					
107	5' - 0"	7' - 0"	0' - 1 1/2"	Paired				
108	6' - 6"	7' - 0"	0' - 1 3/4"	Sliding				
109	3' - 0"	7' - 0"	0' - 1 1/2"					
110	2' - 8"	7' - 0"	0' - 1 3/4"					
111	2' - 10"	7' - 0"	0' - 1 1/2"					
112	2' - 10"	7' - 0"	0' - 1 1/2"					
113	3' - 2"	7' - 0"	0' - 1 1/2"					
114	3' - 0"	7' - 0"	0' - 1 1/2"					
115	2' - 6"	7' - 0"	0' - 1 1/2"					
116	2' - 6"	7' - 0"	0' - 1 1/2"	Bifold				


Schedule		W	Window Schedule			
Panel			Window			
Height	Thickness	Comments	Туре	Width	Height	Sill Height
' - 8"	0' - 1 3/4"		201	5' - 0"	6' - 0"	2' - 0"
' - 0"	0' - 1 1/2"	Bifold	202	3' - 0"	4' - 0"	4' - 0"
' - 0"	0' - 1 1/2"	Bifold	203	5' - 0"	4' - 0"	4' - 0"
' - 0"	0' - 1 1/2"	Paired	204	3' - 0"	6' - 0"	2' - 0"
' - 0"	0' - 1 1/2"	Sliding	205	2' - 0"	2' - 0"	6' - 0"
' - 0"	0' - 1 1/2"	Sliding	206	2' - 0"	6' - 0"	2' - 0"
' - 0"	0' - 1 1/2"		207	6' - 4"	6' - 0"	2' - 0"
' - 0"	0' - 1 1/2"	Paired	208	5' - 0"	5' - 0"	3' - 0"
' - 0"	0' - 1 3/4"	Sliding	209	4' - 0"	2' - 0"	6' - 0"
' - 0"	0' - 1 1/2"					,







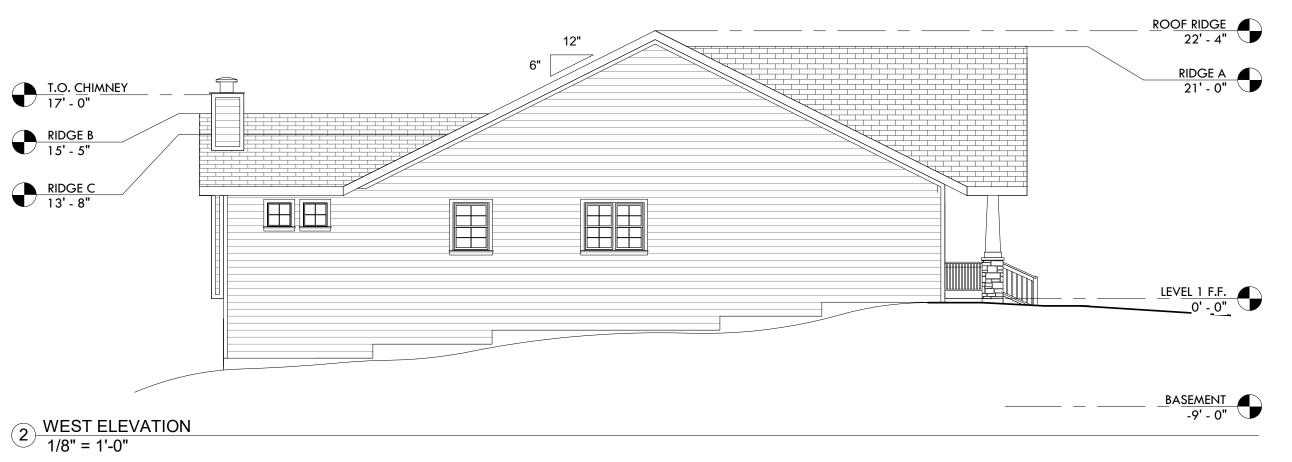

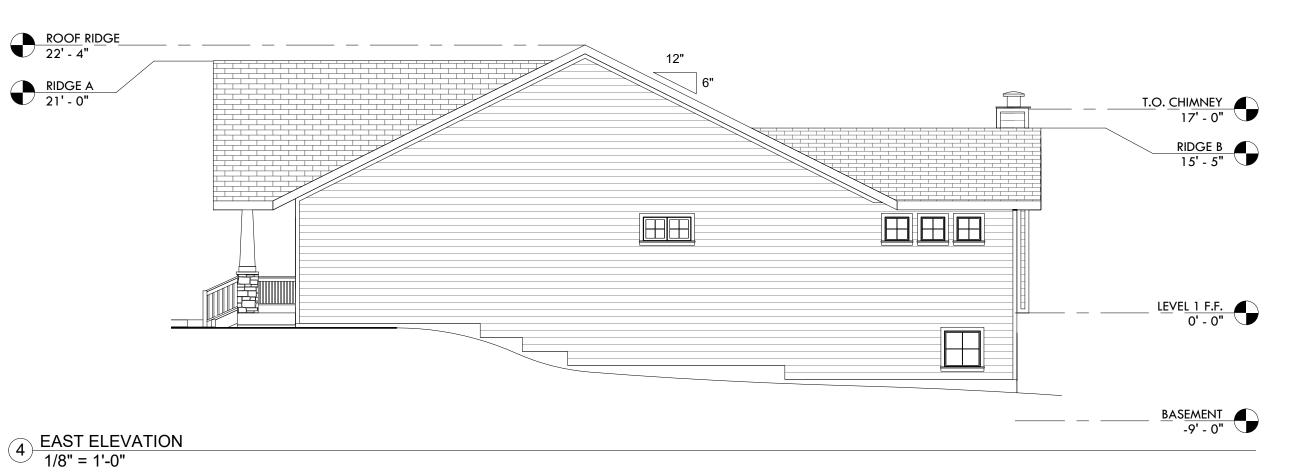

University at Buffalo

Center for Inclusive Design and Environmental Access School of Architecture and Planning

> 309 Hayes Hall Buffalo, NY 14214-8030 TEL: (716) 829-5902

NOT FOR CONSTRUCTION

NOTES

1. EXTERIOR WALL STUDS ARE ASSUMED 2" X 8" (NOM.). VERIFY IF SUFFICIENT GIVEN REGIONAL ENERGY REQUIREMENTS.

2. INTERIOR WALL STUDS ARE ASSUMED 2" X 4"

3. WALLS ARE ASSUMED 92-5/8" PRE-CUT STUDS W/ ONE BOTTOM PLATE & TWO TOP PLATES. 4. FLOOR JOISTS ARE ASSUMED 2" X 10" (NOM.). VERIFY IF SUFFICIENT BASED ON LOCAL CODE & WOOD SPECIES/GRADE.

5. SUBFLOORS ARE ASSUMED 5/8" PLYWOOD. 6. EXTERIOR WALL SHEATHING IS ASSUMED 5/8" PLYWOOD. SIDING IS NOT DEPICTED IN PLAN VIEW. 7. INTERIOR WALL FINISHES ARE ASSUMED $\frac{1}{2}$ " DRYWALL.

8. CEILING FINISH IS ASSUMED 5/8" DRYWALL. 9. INTERIOR FLOOR FINISHES ARE NOT DEPICTED IN THIS WORK. FLOOR FINISHES TO BE SMOOTH, STABLE, FIRM, & SLIP-RESISTANT. WHERE CARPET IS PROVIDED, CARPET PILE IS TO BE NO HIGHER THAN $\frac{1}{2}$ ". TRANSITIONS BETWEEN FLOOR FINISHES SHOULD BE SMOOTH & FLUSH WHEREVER POSSIBLE. WHERE NOT POSSIBLE, THE MAXIMUM VERTICAL LEVEL CHANGE IS $\frac{1}{4}$ ". THE MAXIMUM BEVELED LEVEL CHANGE IS $\frac{1}{2}$ ", PROVIDED THE TOP 1/4" IS BEVELED AT A MAXIMUM SLOPE OF 1:2.

10. ROOF SLOPES ARE EQUAL ON EITHER SIDE OF RIDGE UNLESS OTHERWISE NOTED. 11. COORDINATE DIMENSIONS AT CLOSETS W/ INTENDED ELEVATOR SPECIFICATIONS, WHERE APPLICABLE.

12. HARDSCAPE SLOPES INDICATED FOR REFERENCE ONLY. ACTUAL SLOPES VARY BY SITE. SIDEWALK SLOPES ARE NOT TO EXCEED 5% TO REMAIN WHEELCHAIR ACCESSIBLE WITHOUT THE NEED FOR

13. ALL DIMENSIONS SHOWN ARE MEASURED FROM FACE-OF-STUD UNLESS OTHERWISE NOTED.

ABBREVIATIONS
CLR. - CLEAR
F.F. - FINISH FLOOR
T.O. - TOP OF

LifeHouse

1 STORY: 2 BED, 2 BATH HOME

DATE

Exterior Elevations

2020

A-201